


- ① LANDING LUGS
- ② TEST BYPASS FACILITIES
- ③ SOLID NEUTRAL
- ④ 200 AMP METER SOCKET
- ⑤ A FISHER PIERCE OR APPROVED EQUAL PHOTOELECTRIC CONTROL MOUNT SHALL ALSO BE INSTALLED IN THE SERVICE CABINET
- ⑥ 15A, 1R, TEST SWITCH
- ⑦ 30A, 2P NO CONTACTOR
- ⑧ GROUND ROD

CIRCUIT BREAKER SCHEDULE

- ① MAIN - 200AMP., 240V., 2P.
- ② PHOTOELECTRIC CONTROL - 15AMP., 120V., 1P.
- ③ 240V. STREET LIGHTING - 4, 30AMP., 240V., 2P.
- ④ 120V. STREET LIGHTING - 2, 30AMP., 120V., 1P.

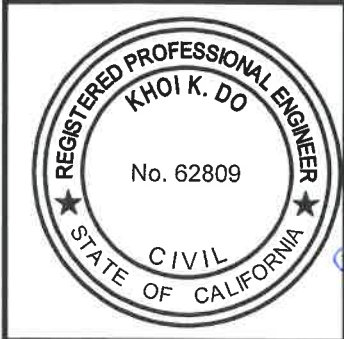

APPROVED BY:		10-12-22	
<i>[Signature]</i>		62809	
KHOI DO, CITY ENGINEER		RCE DATE	
RECOMMENDED:		10/12/22	
<i>[Signature]</i>		62841	
JAY BAUHSTA, TRAFFIC TRANSPORTATION MANAGER		RCE DATE	
REV	DESCRIPTION	BY	APP'D DATE

CITY OF ONTARIO	
STREET LIGHT PEDESTAL WIRING DIAGRAM	STANDARD DRAWING NUMBER 5106