

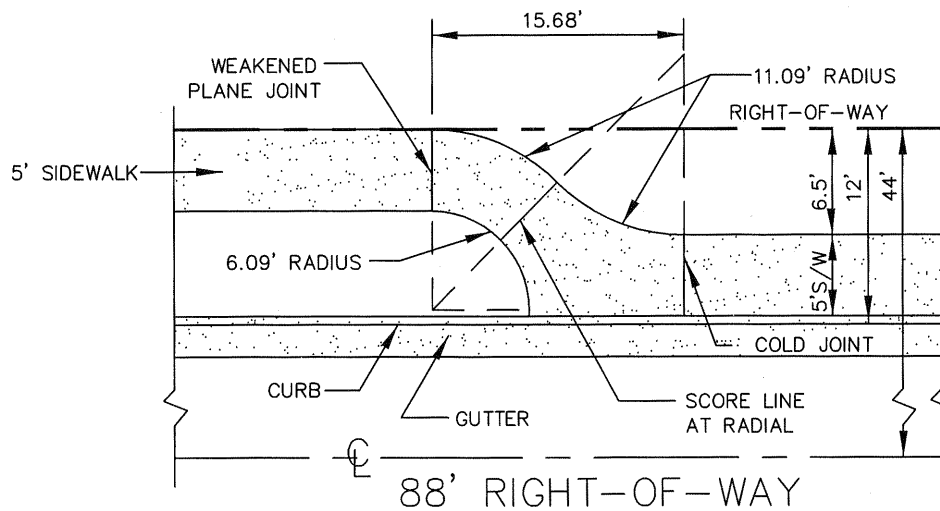


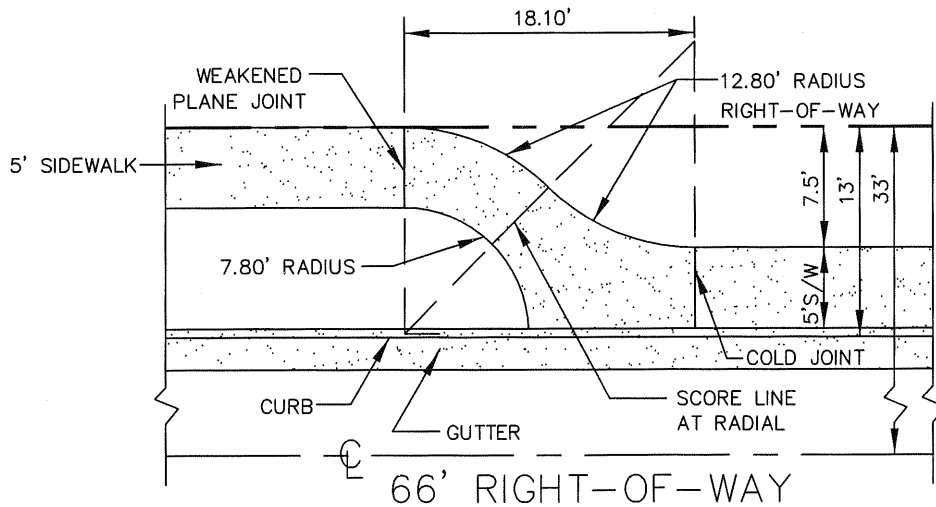

NOTES

1. CONCRETE SHALL BE CLASS 520-C-2500 PER SECTION 201 STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION, CURED WITH TYPE 1-D CURING COMPOUND.
2. CONCRETE SHALL BE 4" THICK.
3. SCORE LINES AND WEAKENED PLANE JOINTS SHALL BE AS INDICATED ABOVE.
4. NO DRIVE APPROACHES SHALL BE ALLOWED IN TRANSITION AREA.

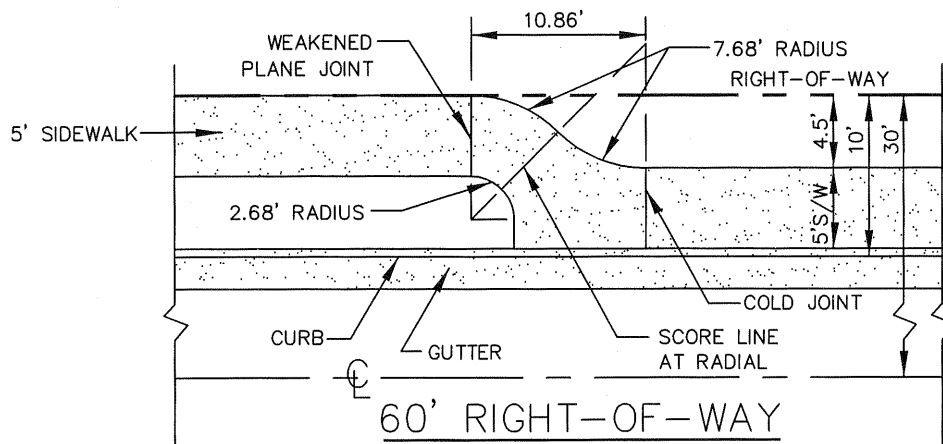

APPROVED BY: <i>John P. Sullivan</i>				
24079 8/08/06				
JOHN P. SULLIVAN CITY ENGINEER RCE DATE				
RECOMMENDED: <i>Jim Mini March</i>				
33340 8/07/06				
JIM MINI MARCH ASSISTANT CITY ENGINEER RCE DATE				
REV	DESCRIPTION	BY	APP'D	DATE

CITY OF ONTARIO

SIDEWALK
CONSTRUCTION
STANDARD TRANSITION

STANDARD
DRAWING
NUMBER

1212