


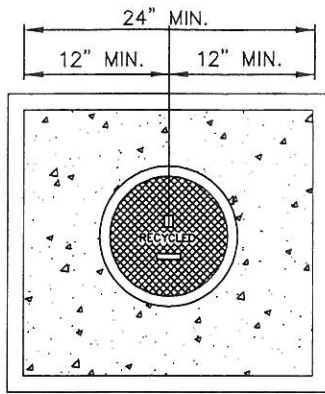
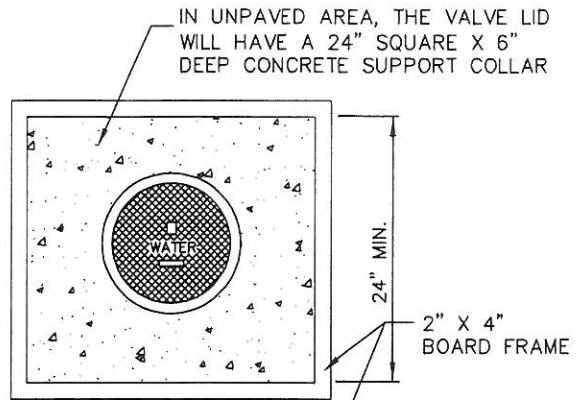
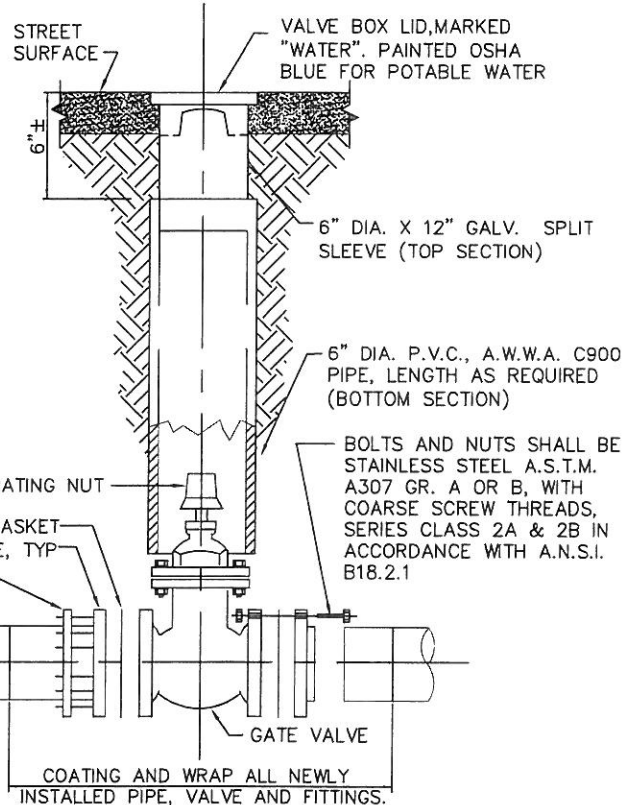


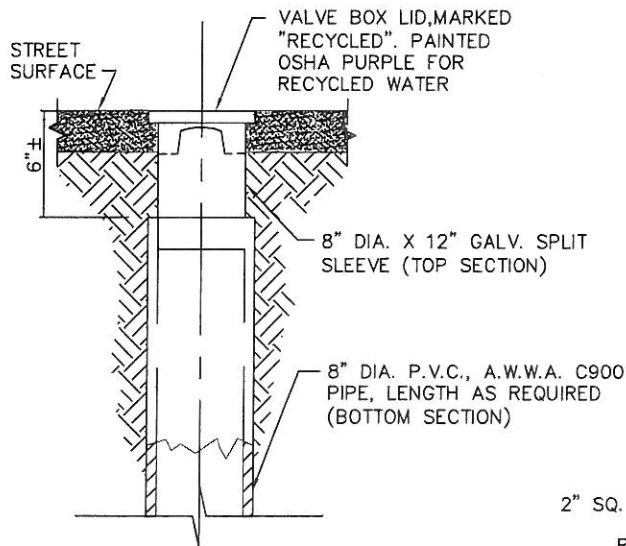

RECYCLED WATER LID



POTABLE WATER LID



#### NOTES

- ① ALL GATE VALVES SHALL BE FLANGED A.W.W.A. C509 OR APPROVED EQUAL.
- ② VALVES LOCATED IN UNPAVED AREAS SHALL HAVE A CONCRETE SUPPORT COLLAR AROUND THE LID.
- ③ INTERIOR & EXTERIOR COATING SYSTEM AND WRAP TO BE APPROVED BY THE CITY.
- ④ GATE VALVE TO BE USED ON WATERLINES 12" AND SMALLER.



|                                                             |             |    |       |      |
|-------------------------------------------------------------|-------------|----|-------|------|
| APPROVED BY: <i>Louis Abi-Younes</i> 11-22-10               |             |    |       |      |
| LOUIS ABI-YOUNES, CITY ENGINEER 44485 RCE DATE              |             |    |       |      |
| RECOMMENDED: <i>Scott Burton</i> 12/25/10                   |             |    |       |      |
| SCOTT BURTON, UTILITIES ENG./OPERATIONS DIRECTOR 57875 DATE |             |    |       |      |
| REV                                                         | DESCRIPTION | BY | APP'D | DATE |
|                                                             |             |    |       |      |

CITY OF ONTARIO

GATE VALVE AND BOX

STANDARD  
DRAWING  
NUMBER

4005