


## ALL CML&C SHALL BE STD. WT. PIPE

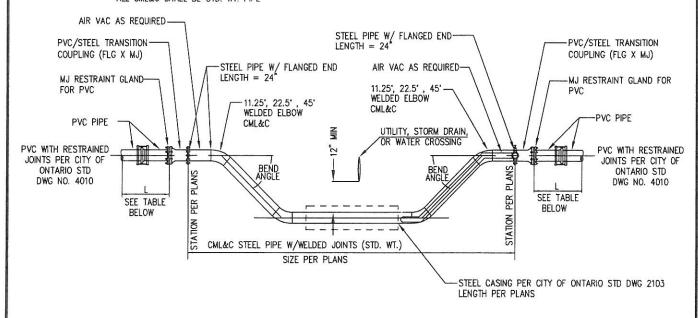





## NOTES

- 1. STEEL CASING TO BE INSTALLED BY JACK AND BORE METHOD WHEN CROSSING EXISTING FACILITIES.
- 2. PIPE MATERIAL SHALL BE PVC FOR THE NEW MODEL COLONY (UP TO 16" IN DIAMETER) AND STEEL OR DUCTILE IRON FOR THE OLD MODEL COLONY.
- 3. WRAP EXPOSED COUPLINGS, RESTRAINT JOINTS AND METALLIC PARTS WITH 8 MIL POLYETHYLENE ENCASEMENT.

