



NOTE:
INSCRIBE "W" OR "RW" ON
THE FACE OF CURB TO
INDICATE WHERE WATER
LATERALS OR RECYCLED
WATER SERVICES CROSS
THE CURB LINE.

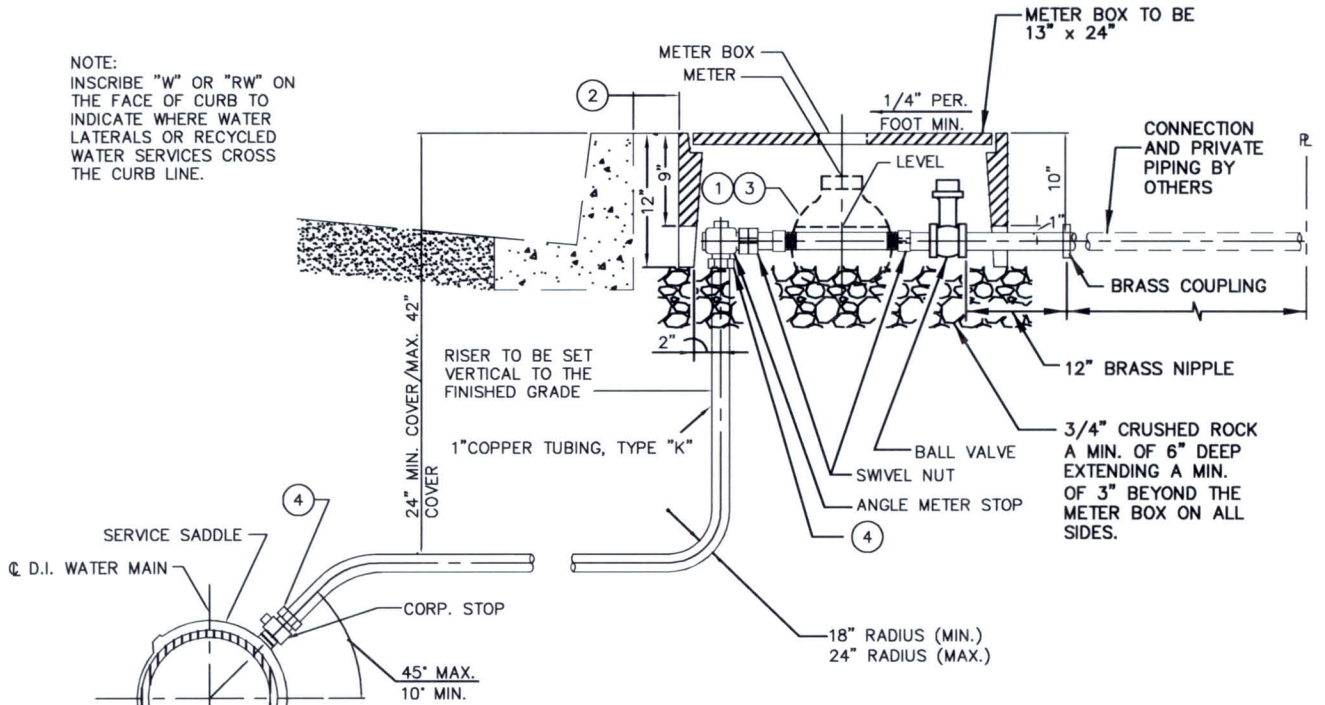

**TYPICAL INSTALLATION-
1" SERVICE DUCTILE IRON MAIN**

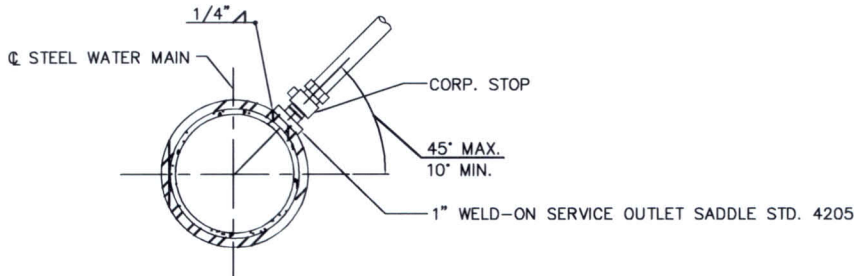

TYPICAL INSTALLATION- 1" SERVICE STEEL MAIN

NOTES:

- ① ALL NEW RESIDENTIAL DEVELOPMENT SHALL UTILIZE THE 3/4" METER, UNLESS OTHERWISE APPROVED BY THE CITY ENGINEER.
- ② FRONT OF METER BOX TO BE LOCATED 6" BEHIND BACK OF WALK FOR SIDEWALK ADJACENT TO CURB AND 6" BACK OF CURB FOR SIDEWALK ADJACENT TO RIGHT OF WAY, UNLESS OTHERWISE SPECIFIED.
- ③ METER SHALL BE SUPPLIED BY THE CITY AT CONTRACTOR'S EXPENSE. 5/8" AND 3/4" METERS REQUIRE 1" X 3/4" ANGLE STOP. 1" METER REQUIRES 1" X 1" ANGLE STOP. NO BUSHINGS.
- ④ ALL FITTINGS TO BE COMPRESSION TYPE, NO FLARED OR SOLDERED FITTINGS SHALL BE USED.



APPROVED BY:				
<i>[Signature]</i>		44485	9.25.14	
LOUIS ABI-YOUNES, CITY ENGINEER		RCE	DATE	
RECOMMENDED:				
<i>[Signature]</i>		62268	9/15/14	
DENNIS MEJA, UTILITIES ENGINEERING DIVISION MGR.		RCE	DATE	
REV	DESCRIPTION	BY	APP'D	DATE

CITY OF ONTARIO	
1" WATER SERVICE w/ 1", 3/4", or 5/8" METER	STANDARD DRAWING NUMBER 4201