




ONTARIO FIRE DEPARTMENT FIRE PROTECTION STANDARD

FIRE HYDRANT IDENTIFICATION
STANDARD #D-002 EFFECTIVE 04-01-2015 PAGES 1

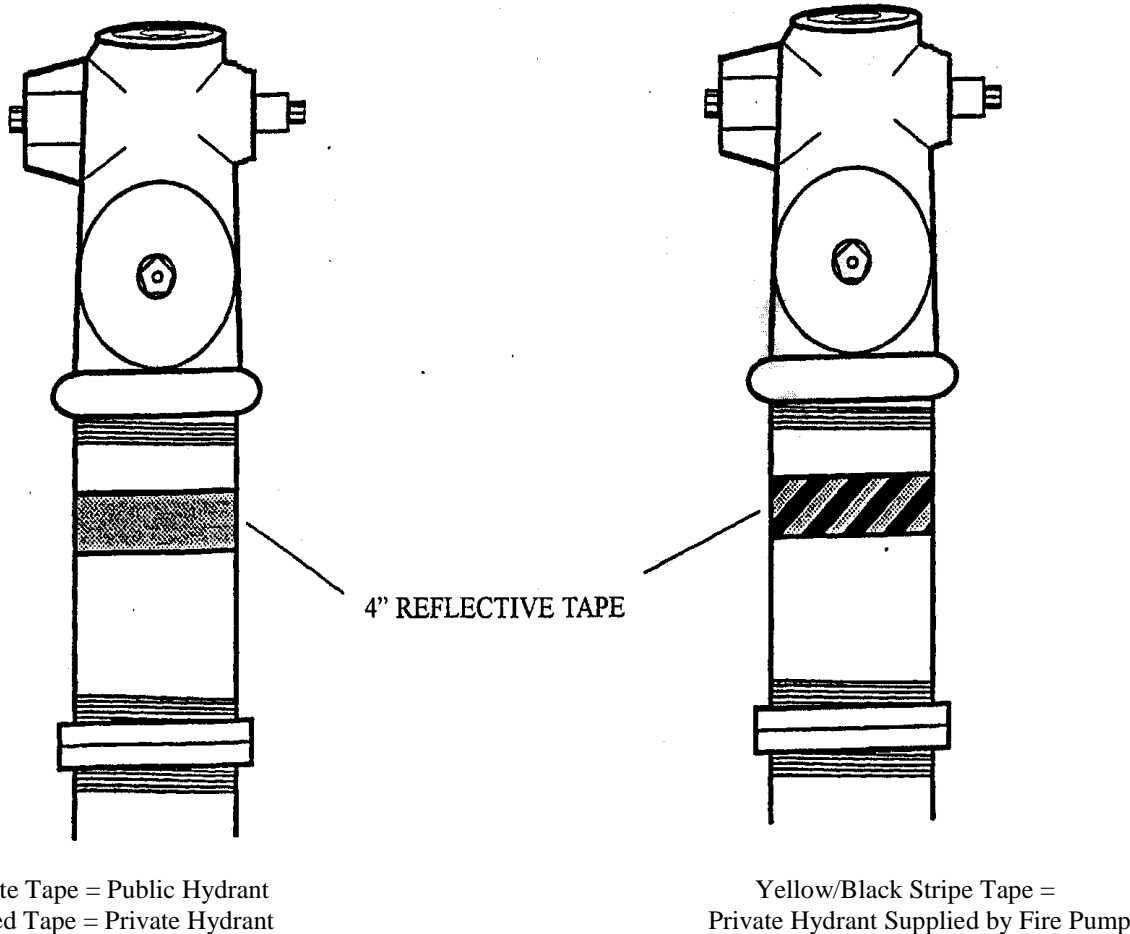

PURPOSE:

This standard is provided to serve as a visual example of the proper identification measures for fire hydrants in the City of Ontario.

SPECIFICATIONS:

1. Prime coat must be Rust-Oleum No. 960 Rust Inhibitive Yellow Primer or approved equal.
2. Finished paint coat shall be Yellow Exterior Enamel or approved equal.
3. Reflective tape shall be 4" wide self-adhesive tape applied with a 1.5" overlap of the seam. Red - 3M™ Scotchlite™ Reflective Striping Tape 79974; yellow/black to be Reflexite AP-1000 or approved equal.
4. Install blue reflective pavement marker per City of Ontario Standard Drawing No. 4302.
5. Do not paint brass hydrant threads.